



POWHATAN COUNTY DECKS, PORCHES, STAIRS AND RAMPS GUIDE

DIRECTIONS

POWHATAN COUNTY DEPARTMENT OF BUILDING INSPECTIONS HAS PREPARED THIS GUIDE FOR BASIC DECKS, PORCHES, STAIRS AND RAMPS. YOU MAY USE IT BY FILLING IN THE DESIGN SHEET(S) WITH THE SPECIFICATIONS OF YOUR DECK OR PORCH.

IF THE DECK OR PORCH IS BEING CONSTRUCTED ON A NEW HOUSE OR IS BEING BUILT AS AN ADDITION TO AN EXISTING HOUSE, CONSTRUCTION DOCUMENTS (i.e. PLANS) ARE REQUIRED, INCLUDING:

1. PLAN VIEW OF THE DECK OR PORCH, INCLUDING THE LOCATION OF THE FOOTINGS,
2. PLAT SHOWING EXACT LOCATION AND DIMENSIONS TO THE PROPERTY LINES.

NOTE: POWHATAN COUNTY ZONING DEPARTMENT HAS MINIMUM REQUIREMENTS FOR SETBACK DISTANCES - CONSULT WITH THEM BEFORE YOU MAKE ANY DECISIONS ABOUT LOCATING YOUR DECK. THE STATE HEALTH DEPARTMENT ALSO HAS RESTRICTIONS AS TO HOW CLOSE A STRUCTURE CAN BE TO A WELL OR SEPTIC SYSTEM - CONSULT WITH THEM IF APPLICABLE.

3. SECTION VIEW OF THE DECK OR PORCH, INCLUDING DETAILS OF THE END AWAY FROM THE HOUSE, AND THE END NEAREST THE HOUSE. THE SECTION SHOULD SHOW THE MATERIALS, THE FOOTINGS AND THE HEIGHTS OF ALL THE COMPONENTS.

SUBMIT

- (1) COPY OF YOUR PLAT PLAN
- (2) COPIES OF THE DECK PLAN AND SPECIFICATION SHEETS,
- (2) COPIES OF THE DETAILS TO BE USED, INCLUDING THE STAIR AND/OR RAMP SHEET.

YOU WILL NEED THE FOLLOWING INSPECTIONS:

- A. FOOTING INSPECTION PRIOR TO THE PLACEMENT OF CONCRETE.
- B. FINAL INSPECTION.

NOTE: THE FOOTING INSPECTION AND FINAL INSPECTION CAN BE COMBINED INTO A SINGLE INSPECTION VISIT IF YOU USE SOLID CONCRETE BLOCKS AS THE FOOTING AND LEAVE THE FOOTINGS EXPOSED FOR THE INSPECTOR.

DECK AND PORCH DESIGN GUIDE

THESE DESIGN SHEETS ARE GUIDELINES FOR A BASIC, SINGLE LEVEL DECKS AND PORCHES. IF A SPA, HOT TUB OR OTHER SPECIAL USE IS INTENDED, SEEK THE HELP OF A REGISTERED DESIGN PROFESSIONAL.

THESE DESIGN SHEETS ARE BASED ON THE PRESCRIPTIVE REQUIREMENTS OF THE 2021 VIRGINIA RESIDENTIAL CODE (VRC) AND IN SOME CASES *EXCEED* THE CODE BASED ON CURRENT "BEST PRACTICES" ENCOURAGED IN POWHATAN COUNTY. THIS DOCUMENT IS NOT INTENDED TO PRECLUDE THE USE OF OTHER CONSTRUCTION METHODS OR MATERIALS.

GENERAL REQUIREMENTS



1. DECK FRAMING IS BASED ON 40 LBS PER SQ FT LIVE LOAD AND 10 LBS PER SQ FT DEAD LOAD. THE PORCH ROOF IS BASED ON 20 LBS PER SQ FT SNOW LOAD AND 10 LBS PER SQ FT DEAD LOAD.
2. ALL DECK MATERIALS SHALL BE PRESERVATIVE TREATED (P.T.) LUMBER OR COMPOSITE MATERIAL SPECIFICALLY DESIGNED FOR DECKS AND EXTERIOR USE, OR FOR USE IN CONTACT WITH THE GROUND. ALL CUT MATERIALS SHALL HAVE THEIR ENDS TREATED WITH AN APPROVED PRESERVATIVE, SUCH AS COPPER NAPHTHENATE.
3. TO RESIST CORROSION FOR USE WITH PRESERVATIVE TREATED (P.T.) WOOD, THE FOLLOWING IS REQUIRED:
 - BORATE TREATED 2X LUMBER MAY NOT BE USED IN CONTACT WITH THE GROUND.
 - ALL SCREWS, BOLTS, NAILS AND FASTENERS SHALL BE HOT-DIPPED GALVANIZED (HDG IN ACCORDANCE WITH ASTM A-153 OR B-695, CLASS 55), STAINLESS STEEL, OR AN APPROVED SPECIAL COATED FASTENER FOR USE WITH ALKALINE COPPER QUAT (ACQ) PRESERVATIVE TREATED LUMBER.
 - WHERE A MATERIAL IS LISTED AS "HDG" IN THIS GUIDE, ANY OF THE ABOVE MENTIONED MATERIALS MAY BE SUBSTITUTED.
4. FLASHING SHALL BE A MINIMUM 19 MIL THICK CORROSION-RESISTANT METAL OR AN APPROVED NON-METALLIC MATERIAL. BRIGHT ALUMINUM FLASHING IS NOT ALLOWED.
5. IF YOU ARE ATTACHING THE DECK TO THE HOUSE, THE HOUSE SHALL HAVE A PRESERVATIVE TREATED NOMINAL SIZE, WOOD BAND BOARD ALONG THE ENTIRE LENGTH OF THE ATTACHMENT AREA. PLYWOOD IS NOT ACCEPTABLE.
6. WHERE THRU BOLTS ARE TO BE USED, COMPATIBLE SIZED WASHERS AND NUTS ARE ASSUMED TO BE PART OF THE ASSEMBLY.
7. DO NOT ATTACH THE LEDGER BOARD TO OR THROUGH STONE OR MASONRY VENEER.
8. DO NOT CONSTRUCT FOOTINGS OVER UTILITY LINES. CALL MISS UTILITY AT 811 BEFORE YOU START!
9. DO NOT CONSTRUCT THE FOOTINGS OVER A SEPTIC FIELD. SEEK ADVICE FROM THE STATE HEALTH DEPARTMENT.
10. DO NOT ATTACH A DECK OR PORCH TO A MANUFACTURED HOME.
11. POWHATAN DOES NOT PERMIT "ON-GRADE DECK BLOCKS" TO BE USED. THESE ARE TAPERED SHAPED CONCRETE BLOCKS INTENDED TO BE SET ON THE TOP OF THE SOIL. THEY HAVE SLOTS AND RECESSES IN THEM FOR STRUCTURAL MEMBERS.

HOW TO USE THIS GUIDE


1. DECIDE ON THE APPROXIMATE DIMENSIONS AND LOCATION OF THE DECK OR PORCH YOU WANT TO BUILD.
2. DECIDE ON THE FRAMING STYLE YOU PREFER: FREE STANDING, CANTILEVERED, FLUSH, ETC.
3. SKETCH THE DECK. ADD DIMENSIONS FOR THE LENGTH AND THE WIDTH.
4. MAKE DECISIONS ON THE MATERIALS YOU WANT TO USE.
 - A. DECIDE ON THE SIZE OF DECK.
 - B. DECIDE ON THE NUMBER OF FOOTINGS.
 - C. SIZE THE STRUCTURAL COMPONENTS USING THE CHARTS INCLUDED ON SHEET 3
 1. BEAM(S)
 2. JOISTS
 3. DECK POSTS
 4. FOOTINGS
 5. DECK BOARDS
 6. RAFTERS (IF APPLICABLE)
4. DRAW THE FINAL PLAN OF YOUR DECK. ADD DIMENSION LINES SHOWING THE TOTAL LENGTH AND WIDTH OF THE DECK; ADD OTHER DIMENSIONS FOR CANTILEVER LENGTHS, POST SPACING, BEAM SPACING, ETC.
5. DRAW A PLAN OF YOUR PROPERTY (REFERRED TO AS A "PLAT"). SKETCH YOUR HOUSE AND SHOW WHERE THE DECK IS INTENDED TO BE CONSTRUCTED. PROVIDE DIMENSIONS OF THE DECK TO YOUR PROPERTY LINES.
6. FOR YOUR CONVENIENCE, WE HAVE PROVIDED TYPICAL CROSS-SECTION SKETCHES OF VARIOUS CONNECTIONS ON SHEET 4. USE THEM IF YOU PREFER, OR DESIGN YOUR OWN DETAILS AND PROVIDE YOUR SKETCHES. IF YOU DO NOT ADD YOUR OWN DETAILS, WE WILL ASSUME THAT YOU WILL BE CONSTRUCTING THE DECK WITH THE COUNTY DECK GUIDE DETAILS, AND IT WILL BE INSPECTED BASED ON THOSE DETAILS.

STANDARD ABBREVIATIONS

HDG - HOT DIPPED GALVANIZED (IN ACCORDANCE WITH ASTM A-153 OR B695, CLASS 55)
O.C. - ON CENTER
P.T. - PRESERVATIVE TREATED
FT - FEET
IN - INCH

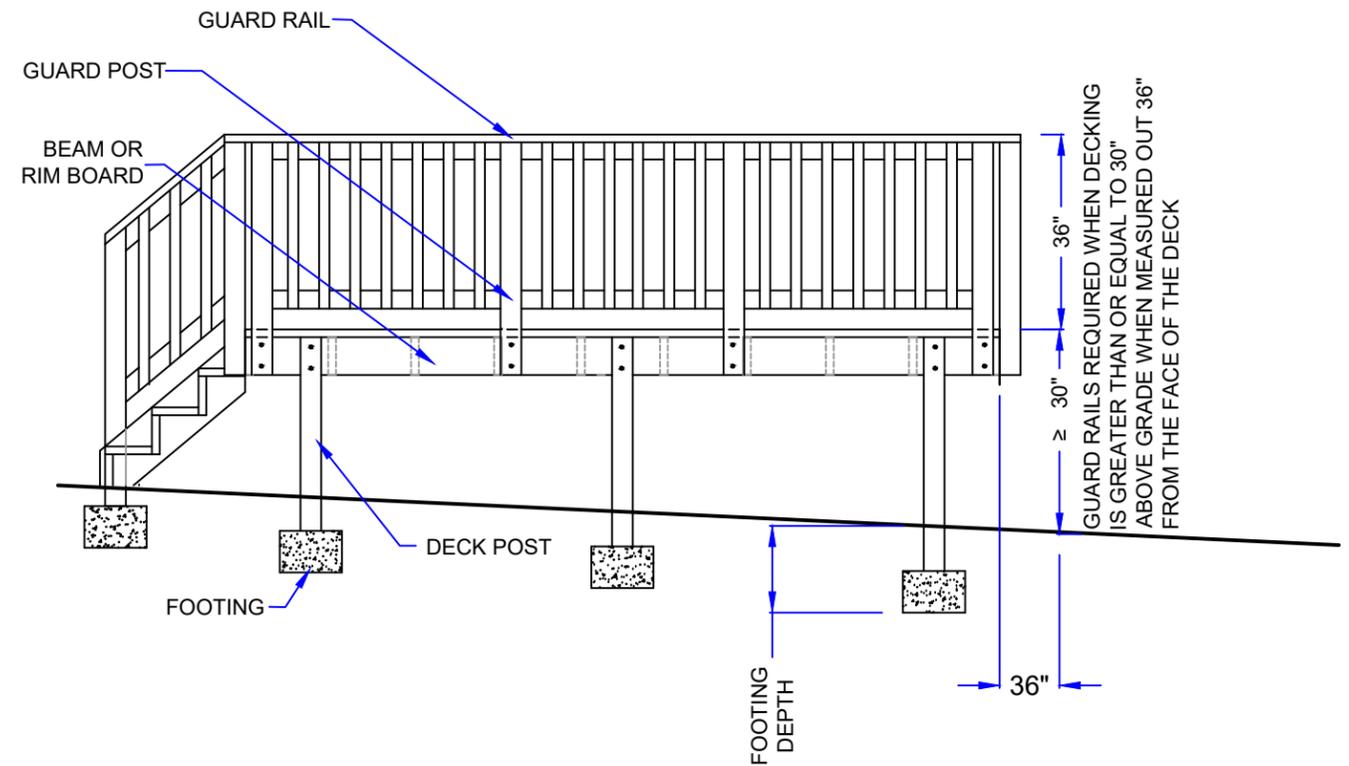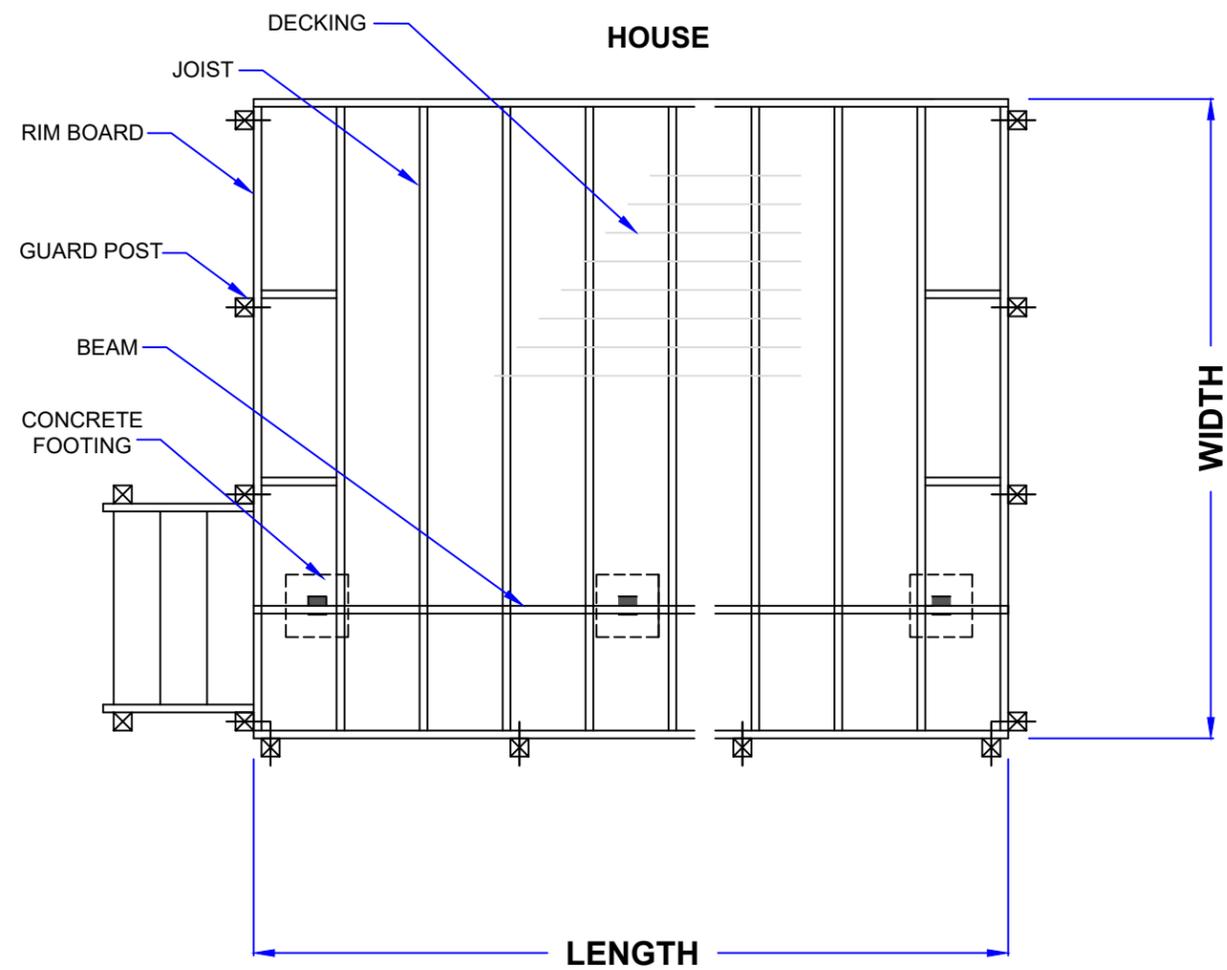

TYPICAL FRONT VIEW

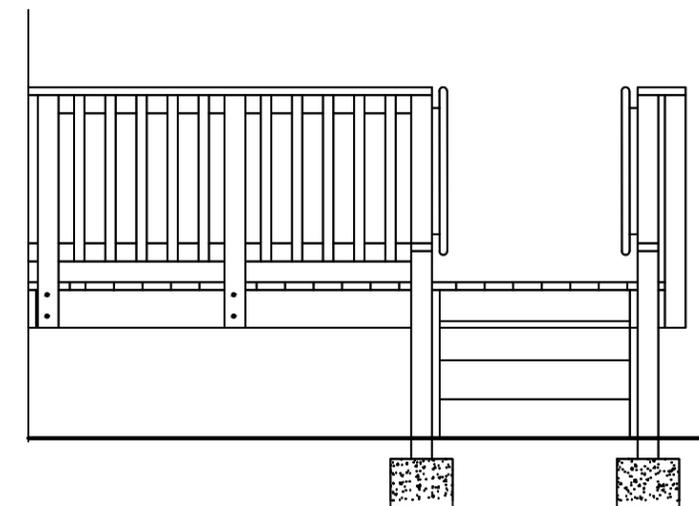


SIDE VIEW

DECK DETAILS

SKETCH YOUR DECK HERE IF IT IS A SIMPLE LAYOUT.
SHOW HOW MANY AND APPROXIMATE LOCATION OF FOOTINGS YOU WILL BE USING.

IF IT IS COMPLEX, PROVIDE A SEPARATE SHEET WITH DIMENSIONS TO BEAMS, CANTILEVERS, AND POSTS.

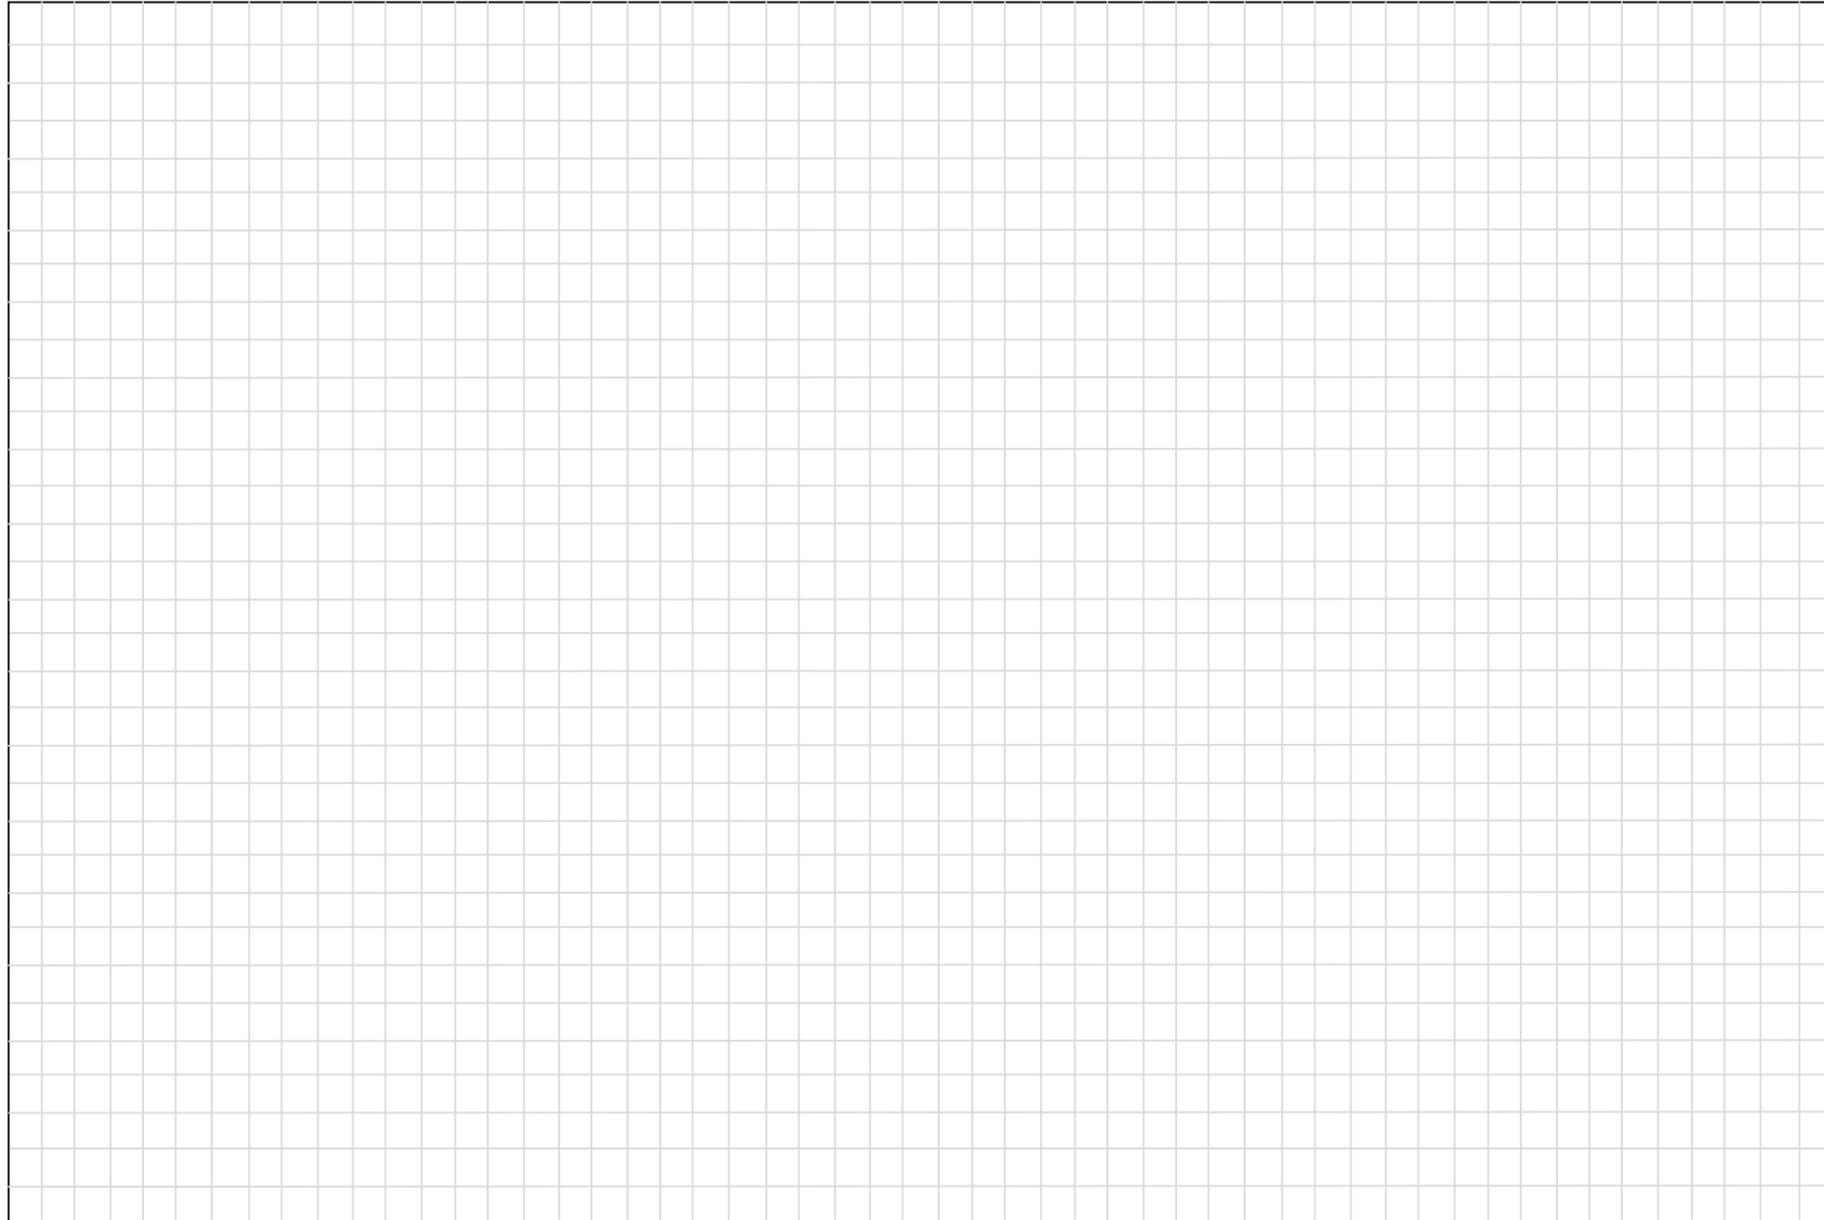

DECK PLAN SPECIFICATIONS

Fill in all the blanks

Example

OVERALL DIMENSIONS

LENGTH _____ FT 10 FT
 WIDTH _____ FT 8 FT
 MAX. HEIGHT ABOVE GRADE _____ FT 3 FT

FREE STANDING _____ YES
 (i.e. minimum of 2 beams)

CANTILEVERS BEAMS _____ IN 24 IN
 (0 means there is none) JOISTS _____ IN 0 IN

DECK POSTS

POST SIZE OR PIER SIZE _____ x _____ IN 6 x 6 IN
 (see sheet 3)
 POST SPACING _____ FT O.C. 5 FT O.C.

FOOTINGS

FOOTING SIZE _____ x _____ x _____ IN 12 x 12 x 8 IN
 (see sheet 3)
 FOOTING DEPTH (minimum 12" of backfill around post or mechanical fastener required) _____ IN 18 IN
 NUMBER OF FOOTINGS _____ TOTAL 6 TOTAL

BEAMS


BEAM SIZE (see sheet 3) (_____) 2 x _____ (2) 2 x 8

JOISTS

JOIST SIZE (see sheet 3) 2 x _____ @ _____ IN O.C. 2X8 @ 16" O.C.

DECKING

DECKING BOARD SIZE _____ 5/4" BOARDS
 2X6, 5/4" BOARDS OR OTHER (see sheet 3)

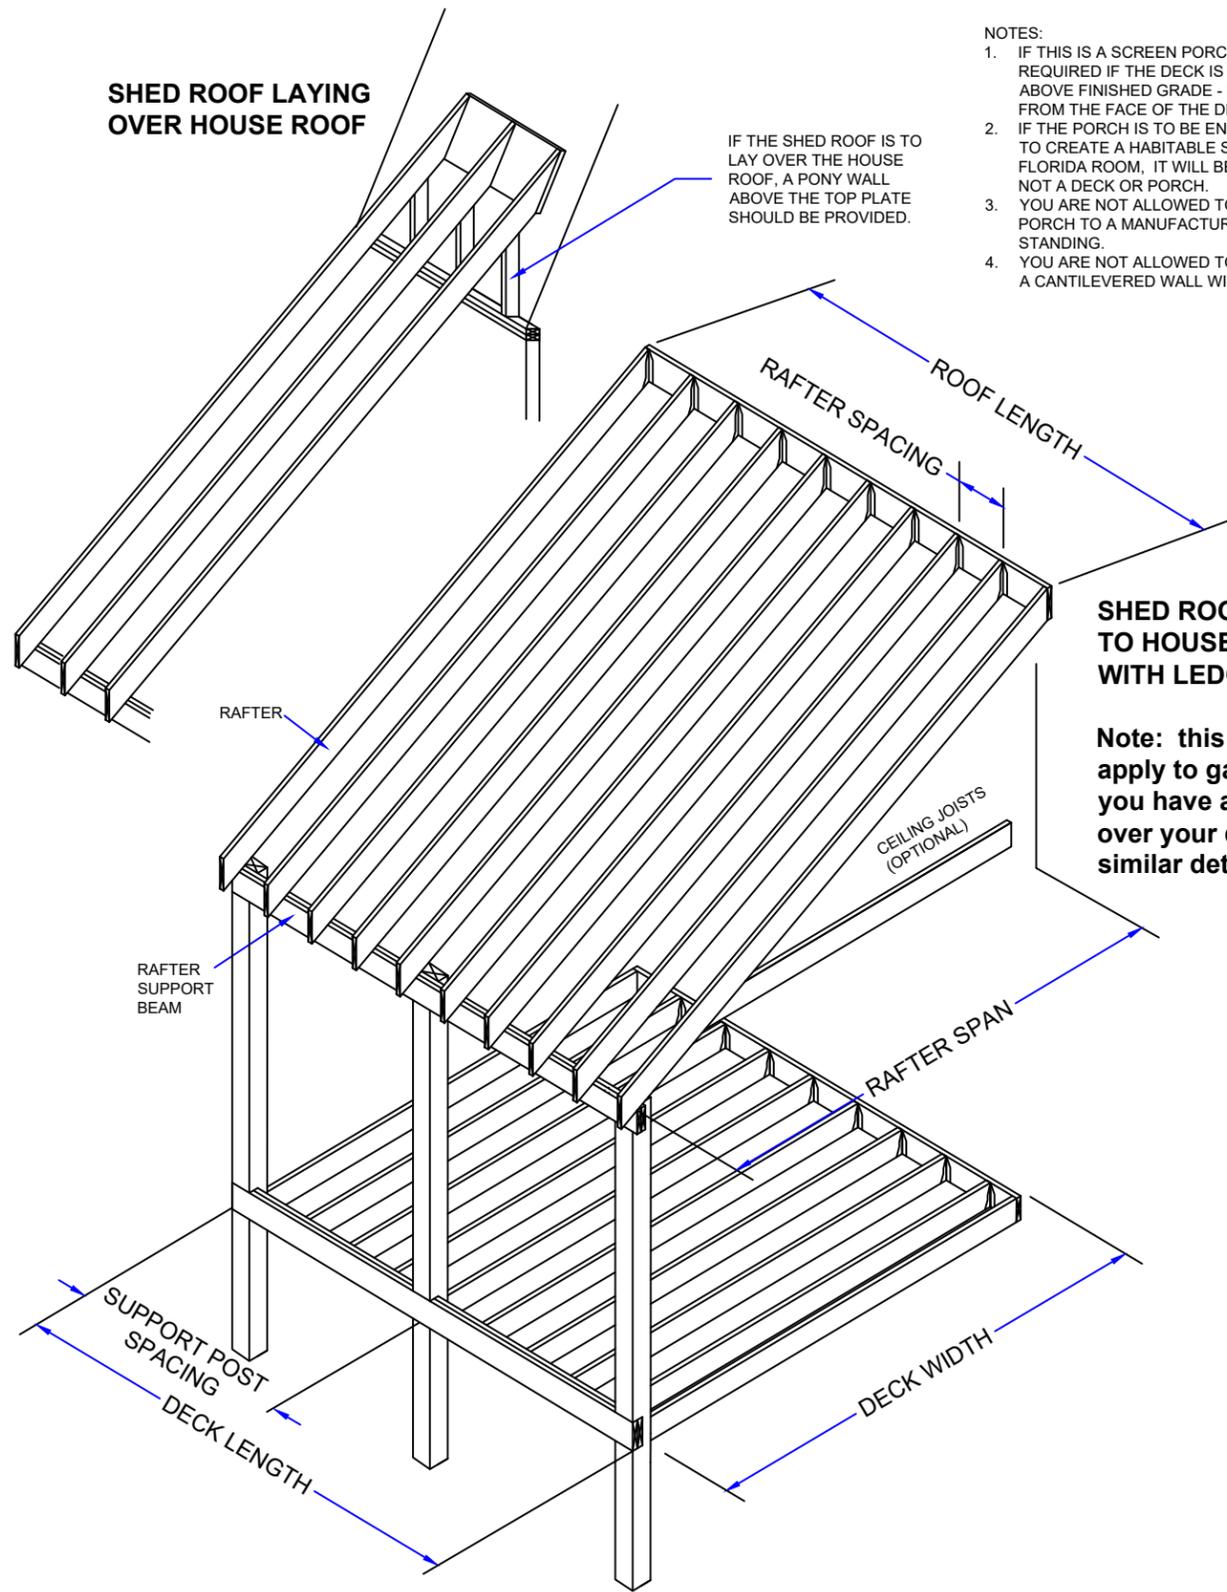

- NOTES:
1. IF THIS IS A SCREEN PORCH, A GUARDRAIL WILL BE REQUIRED IF THE DECK IS GREATER THAN 30 INCHES ABOVE FINISHED GRADE - MEASURED AT 36 INCHES FROM THE FACE OF THE DECK.
 2. IF THE PORCH IS TO BE ENCLOSED WITH SOLID WALLS TO CREATE A HABITABLE SPACE, SUNROOM OR FLORIDA ROOM, IT WILL BE CONSIDERED AN ADDITION, NOT A DECK OR PORCH.
 3. YOU ARE NOT ALLOWED TO CONNECT A DECK OR PORCH TO A MANUFACTURED HOME. IT MUST BE FREE STANDING.
 4. YOU ARE NOT ALLOWED TO ATTACH A SHED ROOF TO A CANTILEVERED WALL WITHOUT ENGINEER'S DESIGN.

IF THE SHED ROOF IS TO LAY OVER THE HOUSE ROOF, A PONY WALL ABOVE THE TOP PLATE SHOULD BE PROVIDED.

SHED ROOF ATTACHED TO HOUSE STUD WALLS WITH LEDGER

Note: this detail does not apply to gable end roof. If you have a gable roof over your deck, provide similar details.


MINIMUM RAFTER SUPPORT BEAM						
POST SPACING (FT)	RAFTER SPAN (FT)					
	6	8	10	12	14	16
4	(1) 2X6	(1) 2X6	(1) 2X6	(1) 2X6	(1) 2X6	(1) 2X8
5	(1) 2X6	(1) 2X6	(1) 2X6	(1) 2X6	(1) 2X8	(1) 2X8 or (2) 2x6
6	(1) 2X6	(1) 2X6	(1) 2X8	(1) 2X8 or (2) 2x6	(1) 2X8 or (2) 2x6	(1) 2X8 or (2) 2x6
7	(1) 2X6	(1) 2X8 or (2) 2x6	(1) 2X8 or (2) 2x6	(1) 2X10 or (2) 2x6	(1) 2X10 or (2) 2x8	(1) 2X12 or (2) 2x8
8	(1) 2X8 or (2) 2x6	(1) 2X8 or (2) 2x6	(1) 2X10 or (2) 2x6	(1) 2X12 or (2) 2x8	(1) 2X12 or (2) 2x8	(1) 2X12 or (2) 2x8
9	(1) 2X8 or (2) 2x6	(1) 2X10 or (2) 2x6	(1) 2X12 or (2) 2x8	(1) 2X12 or (2) 2x8	(2) 2x10	(2) 2X10
10	(2) 2X8	(2) 2x8	(2) 2x8	(2) 2X10	(2) 2X10	(2) 2X12
11	(2) 2x8	(2) 2x8	(2) 2X10	(2) 2X10	(2) 2X12	(2) 2X12
12	(2) 2x8	(2) 2x10	(2) 2X10	(2) 2X12	(2) 2X12	(3) 2X12

MAXIMUM RAFTER SPANS			
SIZE	RAFTER SPACING (o.c.)	MAXIMUM RAFTER SPANS WITH CEILING JOISTS	MAXIMUM RAFTER SPANS WITHOUT CEILING JOISTS
2X4	12"	9'-5"	10'-4"
	16"	8'-7"	9'-0"
	24"	7'-4"	7'-4"
2X6	12"	14-9"	15'-7"
	16"	13'-5"	13'-6"
	24"	11'-0"	11'-0"
2X8	12"	19-6"	19-8"
	16"	17'-1"	17'-1"
	24"	13'-11"	13'-11"
2X10	12"	23-5"	23-5"
	16"	20'-3"	20'-3"
	24"	16'-6"	16'-6"
2X12	12"	>26'-0"	>26'-0"
	16"	23'-10"	23'-10"
	24"	19'-6"	19'-6"

(a) BASED ON 2015 VRC SPAN TABLES FOR SOUTHERN PINE #2. FOR OTHER SPECIES, REFER TO THE CODE BOOK.
 (b) ASSUMES 20 PSF GROUND SNOW LOAD AND 10 PSF DEAD LOAD.

ROOF MEMBER SIZING

SKETCH YOUR ROOF HERE
 IF IT IS A GABLE (A-FRAME) STYLE ROOF BE SURE TO FILL OUT THE CEILING JOIST, RIDGE BEAM, AND POSTING SIZE

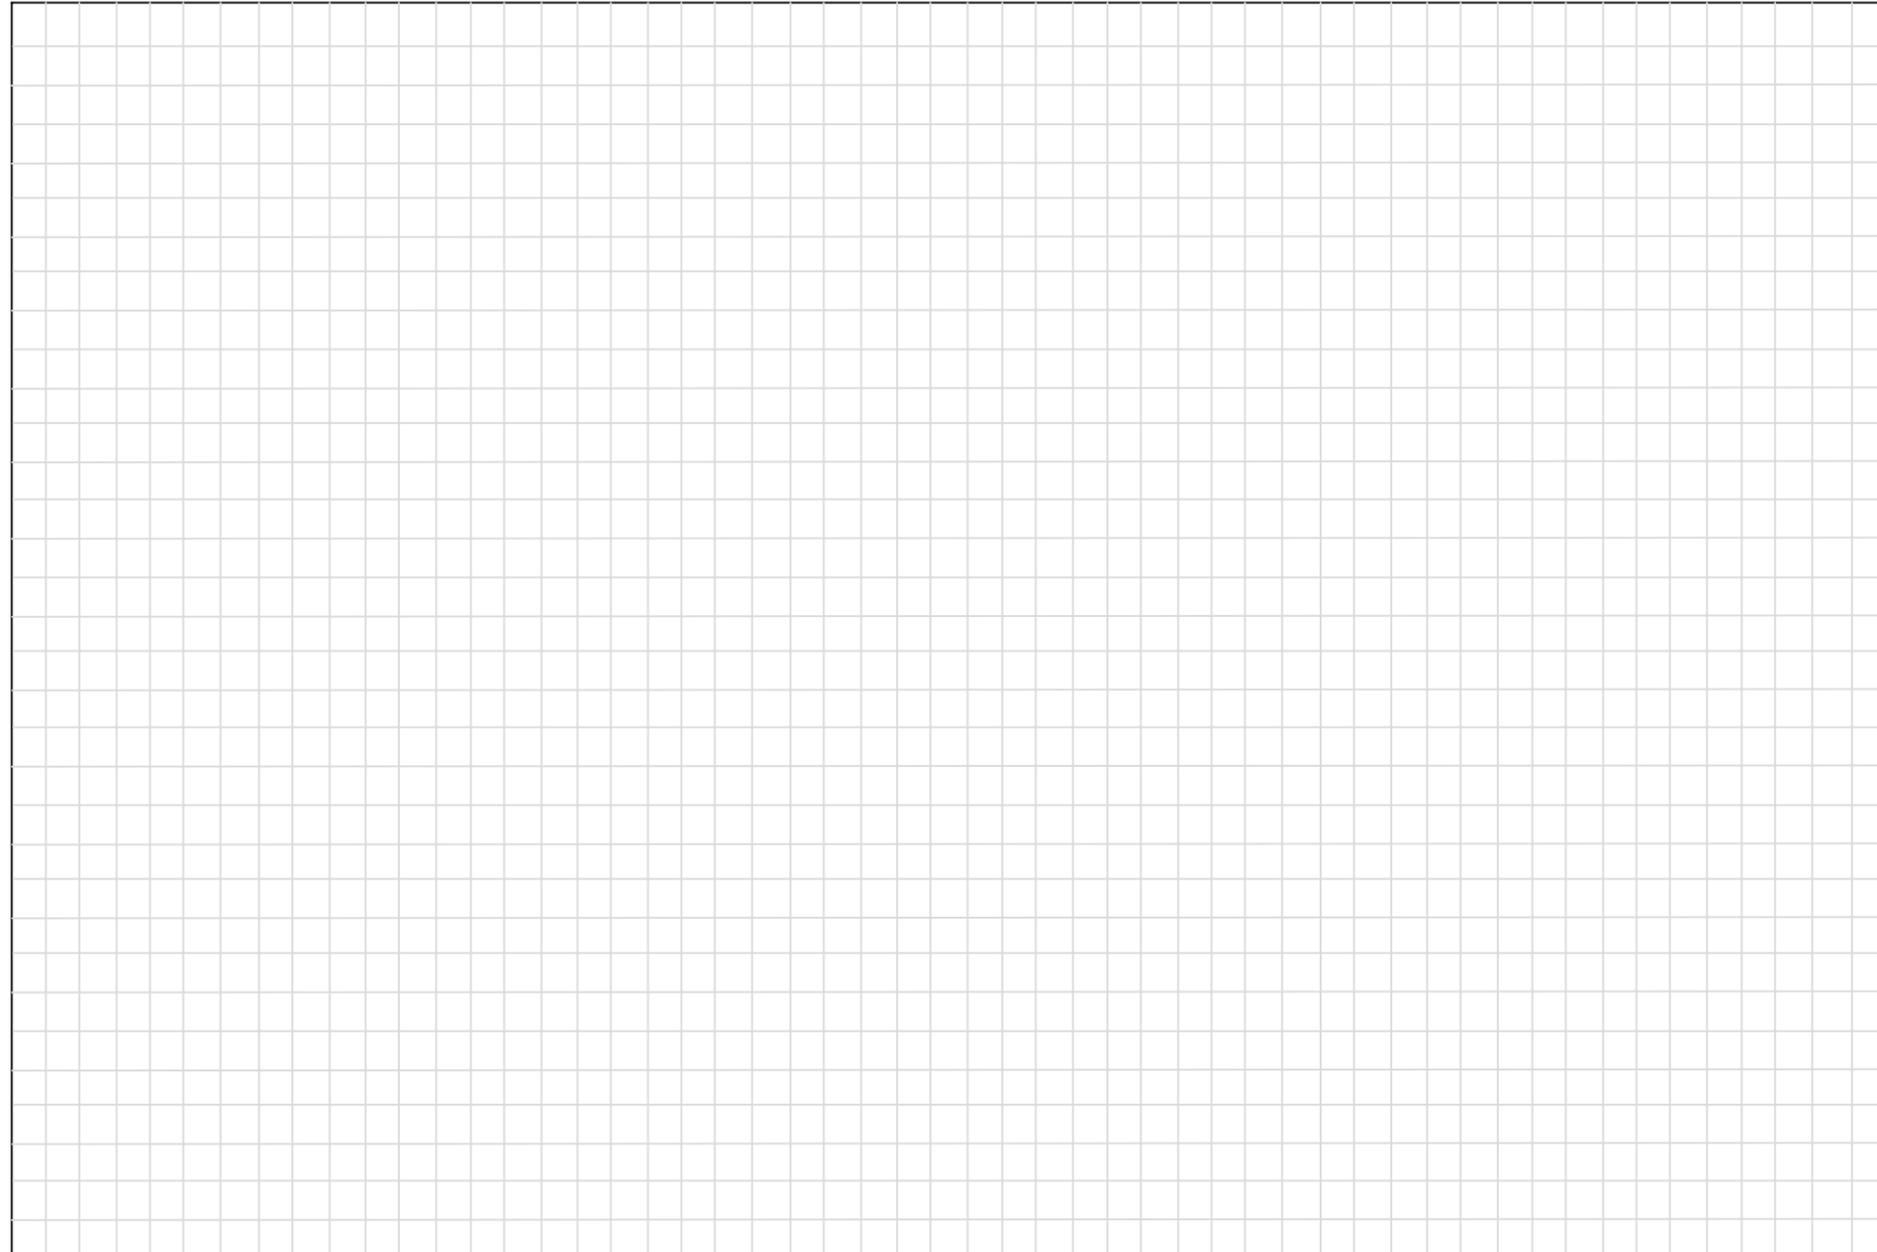

PORCH (ROOF) SPECIFICATIONS

IF APPLICABLE - Fill in all the blanks

ARE YOU CONSTRUCTING A PORCH ON NEW FOOTINGS?

ARE YOU ADDING A ROOF TO AN EXISTING DECK?

NOWHAT STYLE OF ROOF WILL BE CONSTRUCTED?

(IF A GABLE (A-FRAME) ROOF IS CONSTRUCTED PLEASE PROVIDE THE CEILING JOIST SIZE BELOW)

PORCH (ROOF) SPECIFICATIONS

(IF APPLICABLE)

ROOF LENGTH _____ FT

ROOF SPAN _____ FT

ROOF SLOPE _____ : _____ (example 4:12)

ROOF SUPPORT POSTS

POST SIZE _____ X _____

POST SPACING _____ FT

RAFTER SUPPORT BEAM

SIZE (_____) **2** X _____

RAFTERS

SIZE 2 x _____ @ _____ IN O.C.

FILL OUT THE PORTION BELOW IF APPLICABLE (GABLE ROOF / A-FRAME)

CEILING JOIST SIZE (IF A CEILING IS PROVIDED)

JOIST SIZE 2 x _____ @ _____ IN O.C.

RIDGE BEAM SIZE (IF CEILING IS VAULTED)

SIZE (_____) 2 x _____ OR _____ " LVL

RIDGE BEAM POSTING (IF RIDGE BEAM IS USED)

SIZE _____

ROOF SPECIFICATIONS

JOISTS

THE SPAN OF THE JOIST IS MEASURED FROM THE INSIDE EDGE OF BEARING AT ONE END OF THE JOIST TO THE INSIDE EDGE OF BEARING AT THE OTHER END OF THE JOIST, AND DOES NOT INCLUDE THE LENGTH OF THE OVERHANGS (CANTILEVERS).

MAXIMUM JOIST SPAN						
SIZE	12" O.C.		16" O.C.		24" O.C.	
	MAXIMUM SPAN	MAXIMUM SPAN WITH CANTILEVER	MAXIMUM SPAN	MAXIMUM SPAN WITH CANTILEVER	MAXIMUM SPAN	MAXIMUM SPAN WITH CANTILEVER
2X6	9'-11"	6'-8"	9'-0"	6'-8"	7'-7"	6'-8"
2X8	13'-1"	10'-1"	11'-10"	10'-1"	9'-8"	9'-8"
2X10	16'-2"	14'-6"	14'-0"	14'-0"	11'-5"	11'-5"
2X12	18'-0"	18'-0"	16'-6"	16'-6"	13'-6"	13'-6"

- (a) BASED ON THE 2015 VRC TABLE R507.5 FOR SOUTHERN PINE #2.
 (b) CANTILEVER LENGTH IS LIMITED TO $\frac{1}{2}$ OF THE JOIST SPAN.
 (c) BASED ON 40 PSF LIVE LOAD AND 10 PSF DEAD LOAD.

DECKING BOARDS

- DECKING BOARDS ARE TYPICALLY 2x6, 5/4 P.T. BOARDS, OR MANUFACTURED OF COMPOSITE MATERIAL.
- ATTACH DECKING BOARDS TO DECK JOISTS WITH 2-8d HDG NAILS, (2) #8 HDG SCREWS, OR PROPRIETARY FASTENERS INTENDED FOR P.T. WOOD.
- DECK BOARDS SHALL BE SPACED APPROXIMATELY 1/8" APART (EDGE TO EDGE).
- EACH PIECE OF DECKING MUST BEAR ON AT LEAST 3 JOISTS.

MAXIMUM JOIST SPACING		
MATERIAL TYPE AND NOMINAL SIZE	PERPENDICULAR TO JOIST	DIAGONAL TO JOIST
$\frac{5}{4}$ " THICK WOOD	16"	12"
2" THICK WOOD	24"	16"
PLASTIC COMPOSITE	PER R507.3	PER R 507.3

DECK POSTS


- DECK POSTS MAY BE EITHER P.T. WOOD, OR NATURAL DECAY RESISTANT WOOD OR MASONRY.
- 4X4 POSTS CAN BE NOTCHED TO CARRY A 1-PLY BEAM OR CAN CARRY A 2-PLY BEAM USING A POST CAP. A 6X6 POSTS CAN BE NOTCHED TO CARRY A 2-PLY BEAM OR CAN CARRY A 3-PLY BEAM USING A POST CAP.
- DECK POSTS THAT ARE OVER 8' IN HEIGHT SHOULD BE CROSS BRACED IN BOTH DIRECTIONS.

MAXIMUM DECK POST HEIGHT

DECK POST SIZE	ATTACHED DECK
4 x 4	8' - 0"
4 x 6	8' - 0"
6 x 6	14' - 0"

BEAMS

- BEAMS SUPPORT THE DECK JOISTS. THE JOISTS EITHER BEAR ON TOP OF THE BEAM FOR A CANTILEVER DESIGN, OR ARE HUNG FLUSH ALONG SIDE IT WITH MECHANICAL HANGERS.
- TWO OR THREE MEMBERS MAY BE CONNECTED TOGETHER TO FORM THE BEAM USING 10-d HDG NAILS OR #10 HDG SCREWS, STAGGERED IN TWO ROWS, AT 16" O.C.
- WHENEVER FOUR OR MORE MEMBERS ARE USED, THEY SHOULD BE BOLTED TOGETHER WITH 1/2" DIA HDG THRU-BOLTS AT 24" O.C.

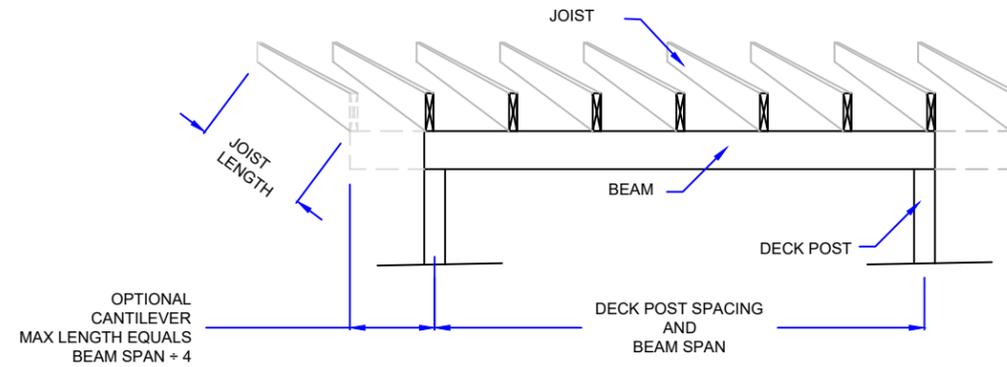


MINIMUM BEAM SIZE				
JOIST LENGTH	6 FT BEAM SPAN	8 FT BEAM SPAN	10 FT BEAM SPAN	12 FT BEAM SPAN
6 FT JOIST SPAN	(2) 2X6	(2) 2X8	(2) 2X10	(2) 2X12
8 FT JOIST SPAN	(2) 2X8	(2) 2X10	(2) 2X12	(3) 2X12
10 FT JOIST SPAN	(2) 2X8	(2) 2X10	(3) 2X10	DESIGN REQUIRED
12 FT JOIST SPAN	(2) 2X8	(2) 2X12	(3) 2X12	DESIGN REQUIRED
14 FT JOIST SPAN	(2) 2X10	(2) 2X12	(3) 2X12	DESIGN REQUIRED
16 FT JOIST SPAN	(2) 2X10	(3) 2X12	DESIGN REQUIRED	DESIGN REQUIRED
18 FT JOIST SPAN	(2) 2X10	(3) 2X12	DESIGN REQUIRED	DESIGN REQUIRED

- (a) BASED ON THE 2015 VRC FOR SOUTHERN PINE #2. ASSUMES 40 PSF LIVE LOAD, 10 PSF DEAD LOAD, WET SERVICE FACTOR.
 (b) BEAM DEPTH MUST BE EQUAL TO OR GREATER THAN THE JOIST DEPTH IF JOIST HANGERS ARE USED.

FOOTINGS

ALL FOOTINGS SHALL BEAR ON UNDISTURBED SOIL AT 18" - 20" BELOW FINISHED GRADE. IF THE FOOTING IS WITHIN 4 FEET OF THE EXISTING HOUSE, IT SHALL BE AT LEAST AS DEEP AS THE HOUSE FOOTING.

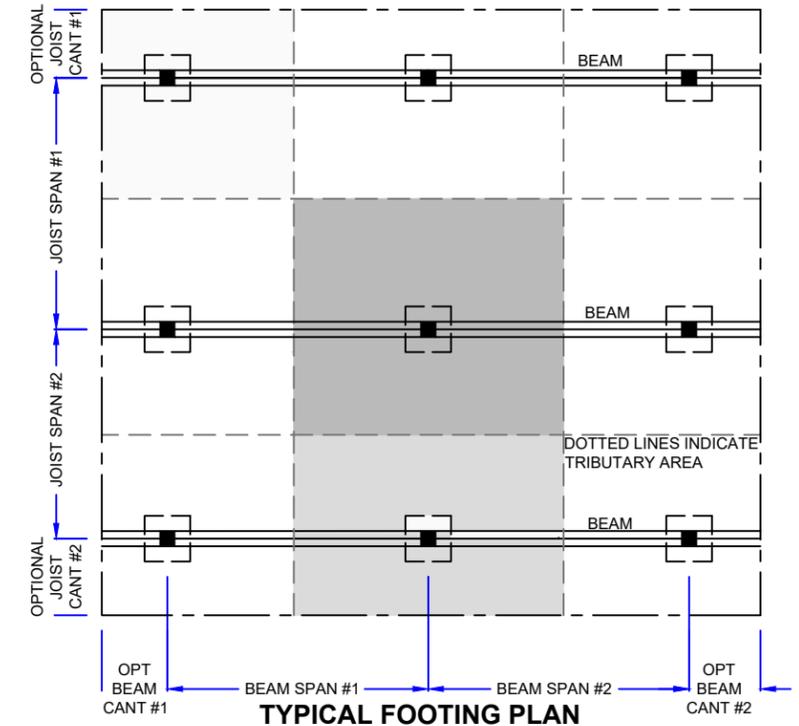


FOOTING SIZE			
TRIBUTARY AREA (b) (SQFT)	SQUARE FOOTING SIDE DIMENSION (INCHES)	ROUND FOOTING DIAMETER (INCHES)	THICKNESS (INCHES)
20	12	14	8
30	12	14	8
40	14	16	8
50	16	18	8
60	17	19	8
70	18	20	8
80	20	22	8
100	22	25	8
120	24	27	10
140	26	29	10
160	28	31	12

- (a) ASSUMES 1500 PSF SOIL BEARING CAPACITY
 (b) THE FOOTING SIZES IN THIS TABLE ASSUME NO ROOF LOAD.
 (c) TRIBUTARY AREA IS DEFINED AS THE AREA INSCRIBED BY ONE-HALF THE LENGTH OF THE SPANS ADJACENT TO ALL FOUR SIDES SURROUNDING THE POST.


TRIBUTARY AREA =

$$[(1/2 \text{ JOIST SPAN \#1} + \text{JOIST CANT \#1}) + (1/2 \text{ JOIST SPAN \#2} + \text{JOIST CANT \#2})] \times [(1/2 \text{ BEAM SPAN \#1} + \text{BEAM CANT \#1}) + (1/2 \text{ BEAM SPAN \#2} + \text{BEAM CANT \#2})]$$

MEMBER SIZING

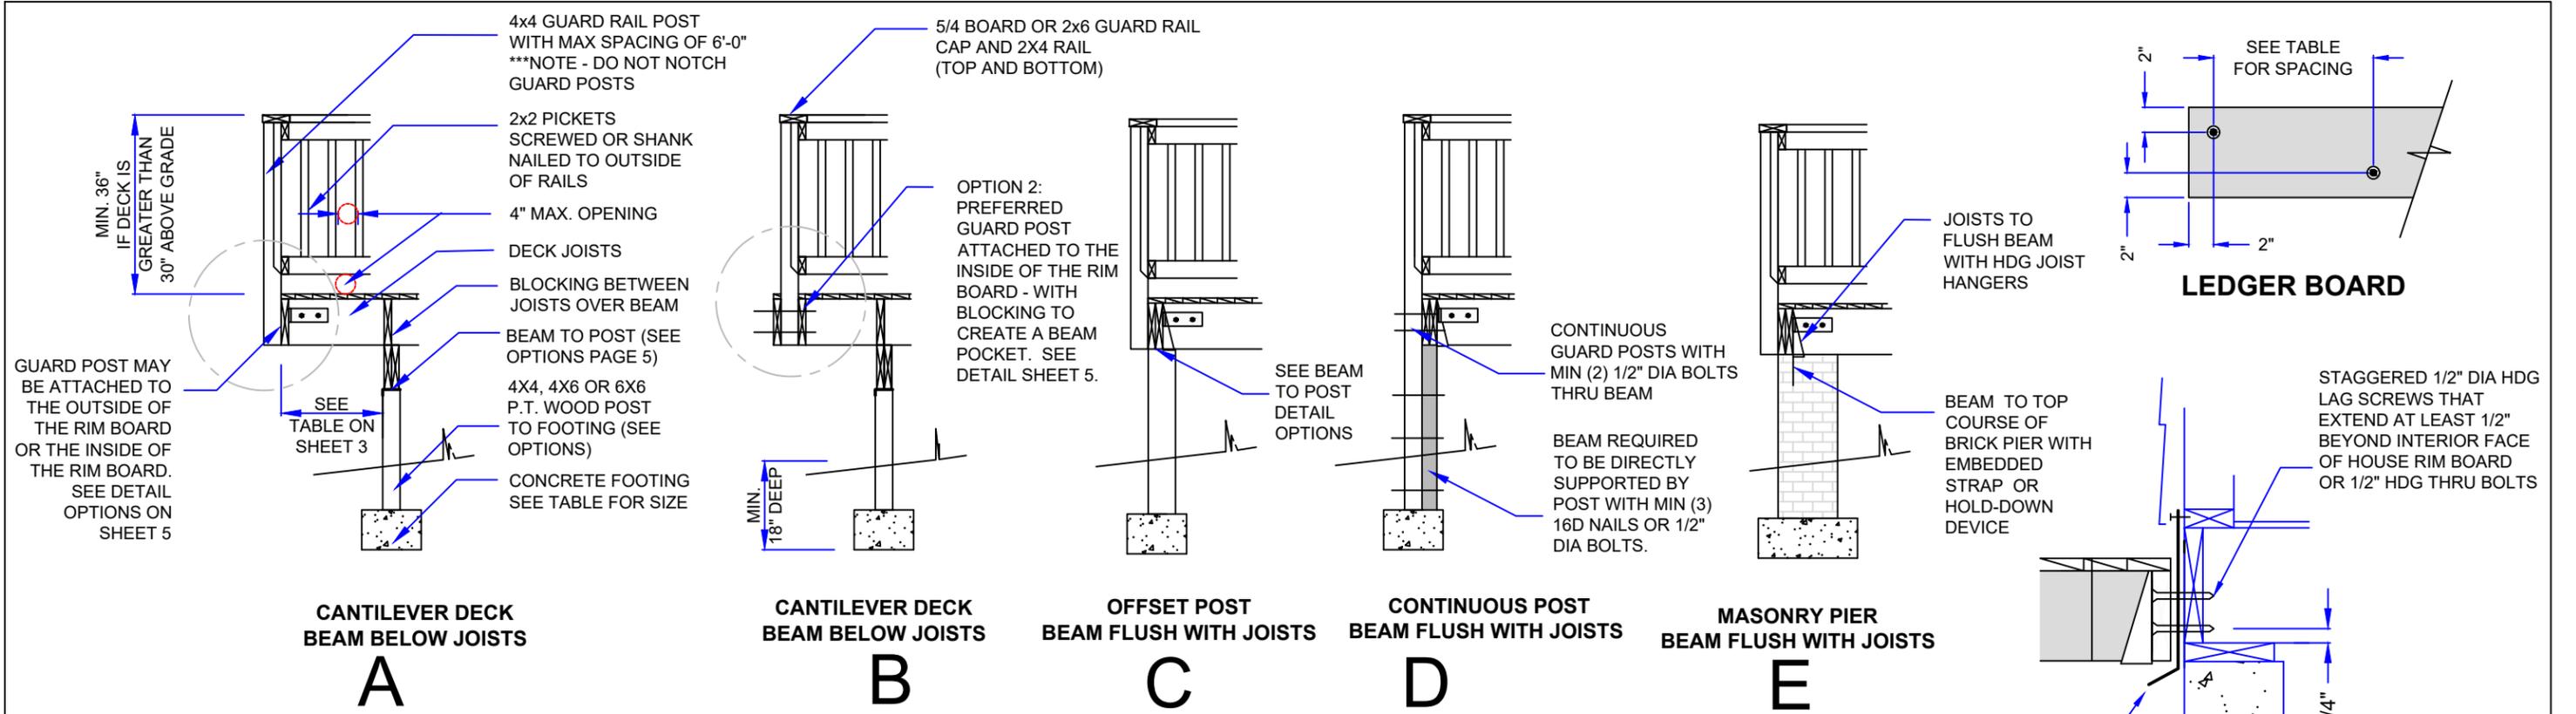

END AWAY FROM THE HOUSE - GUARD POST OUTSIDE RIM BOARD NOTE: DO NOT NOTCH THE GUARD POST.

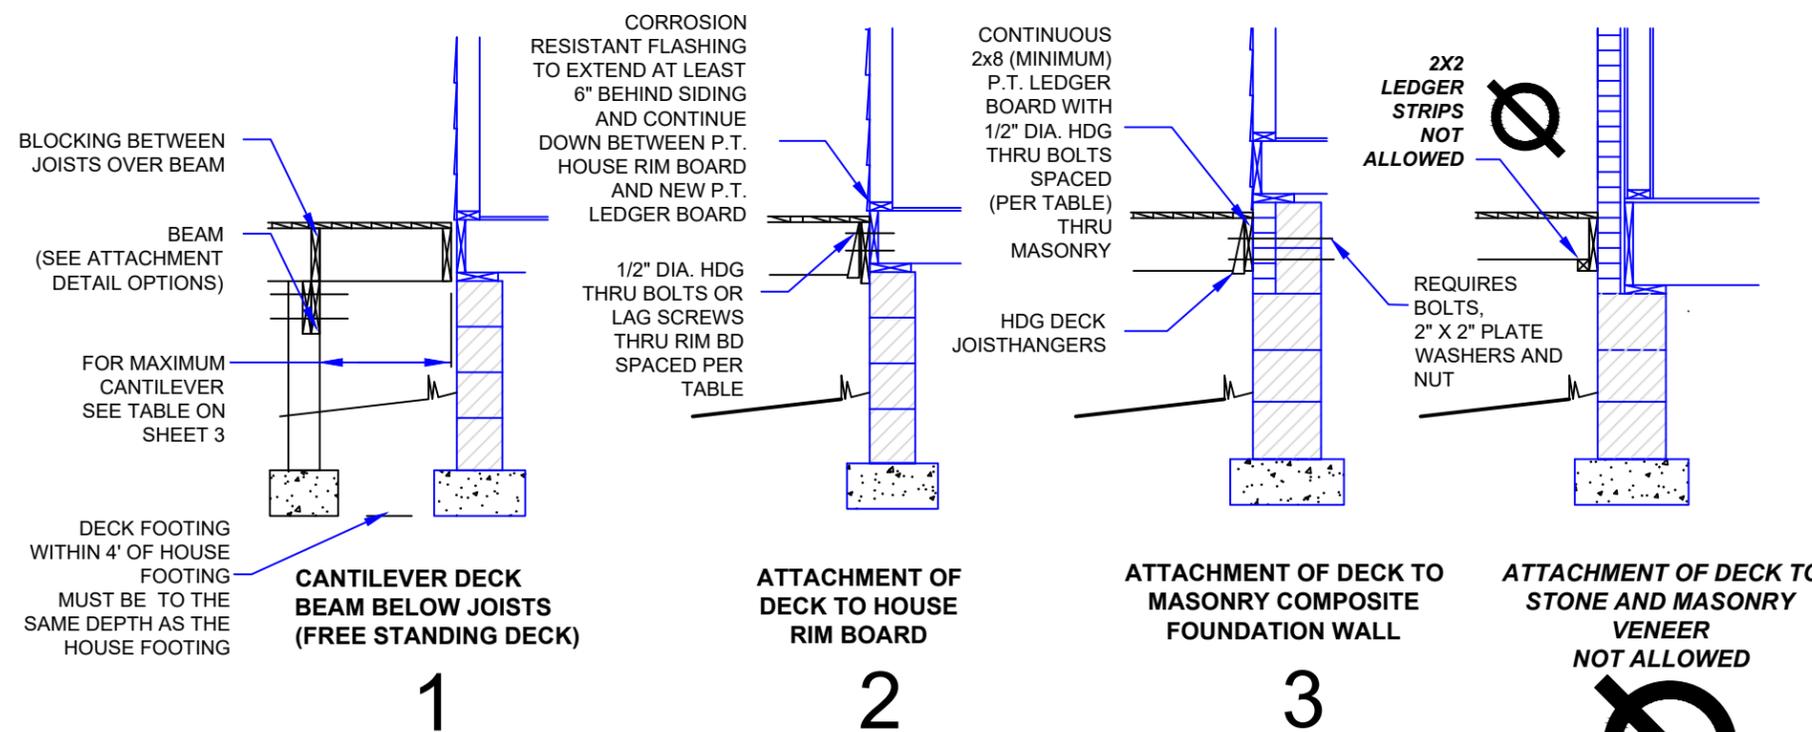

END ADJACENT TO THE HOUSE NOTE: 2X2 LEDGER STRIPS NOT ALLOWED

(1) PIECE OF CORROSION-RESISTANT MINIMUM 19 GA. METAL OR APPROVED NON-METALIC FLASHING BETWEEN HOUSE RIM BOARD AND DECK LEDGER BOARD
NOTE: ALUMINUM FLASHING IS NOT PERMITTED.

LEDGER CONNECTION


LEDGER BOARD CONNECTION TO HOUSE

ON-CENTER SPACING FOR FASTENERS ATTACHING DECK TO HOUSE							
JOIST SPAN (ft)	6' and less	6'-1" 8'-0"	8'-1" 10'-0"	10'-1" 12'-0"	12'-1" 14'-0"	14'-1" 16'-0"	16'-1" 18'-0"
1/2" x 4" LAG SCREWS	30"	23"	18"	15"	13"	11"	10"
1/2" x 4" BOLTS WITH WASHERS AND NUTS	36"	36"	34"	29"	24"	21"	19"


NOTES:

1. THE MAXIMUM GAP BETWEEN THE FACE OF THE LEDGER BOARD AND FACE OF THE HOUSE BAND JOIST SHALL BE 1/2".
2. THE TIP OF THE LAG SCREW SHALL FULLY EXTEND BEYOND THE INSIDE OF THE BAND JOIST (BOARD).
3. LEDGERS SHALL BE FLASHED TO PREVENT WATER FROM CONTACTING THE HOUSE BAND JOIST (BOARD).
4. LAG SCREWS AND BOLTS SHALL BE STAGGERED AND CANNOT BE CLOSER THAN 2" TO THE EDGE OF THE LEDGER.
5. DECK LEDGERS SHALL BE 2X8 PRESERVATIVE TREATED SOUTHERN PINE (MINIMUM) OR OTHER APPROVED METHOD AND MATERIAL AS ESTABLISHED BY STANDARD ENGINEERING PRACTICE.

CONNECTIONS

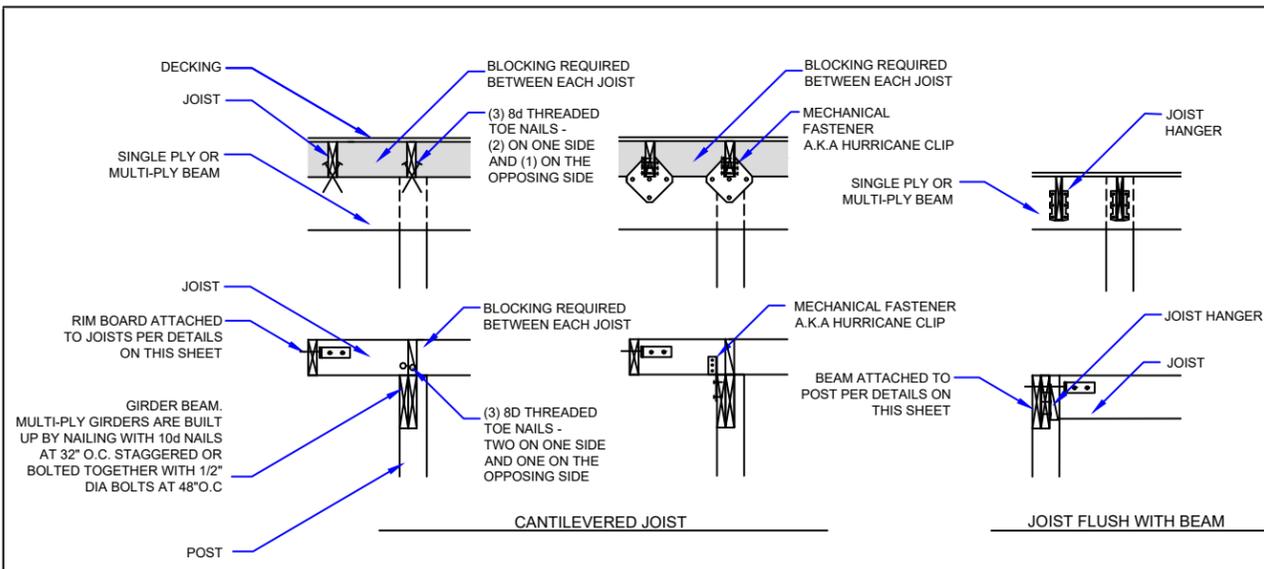


TYPICAL JOISTS TO BEAM CONNECTION OPTIONS

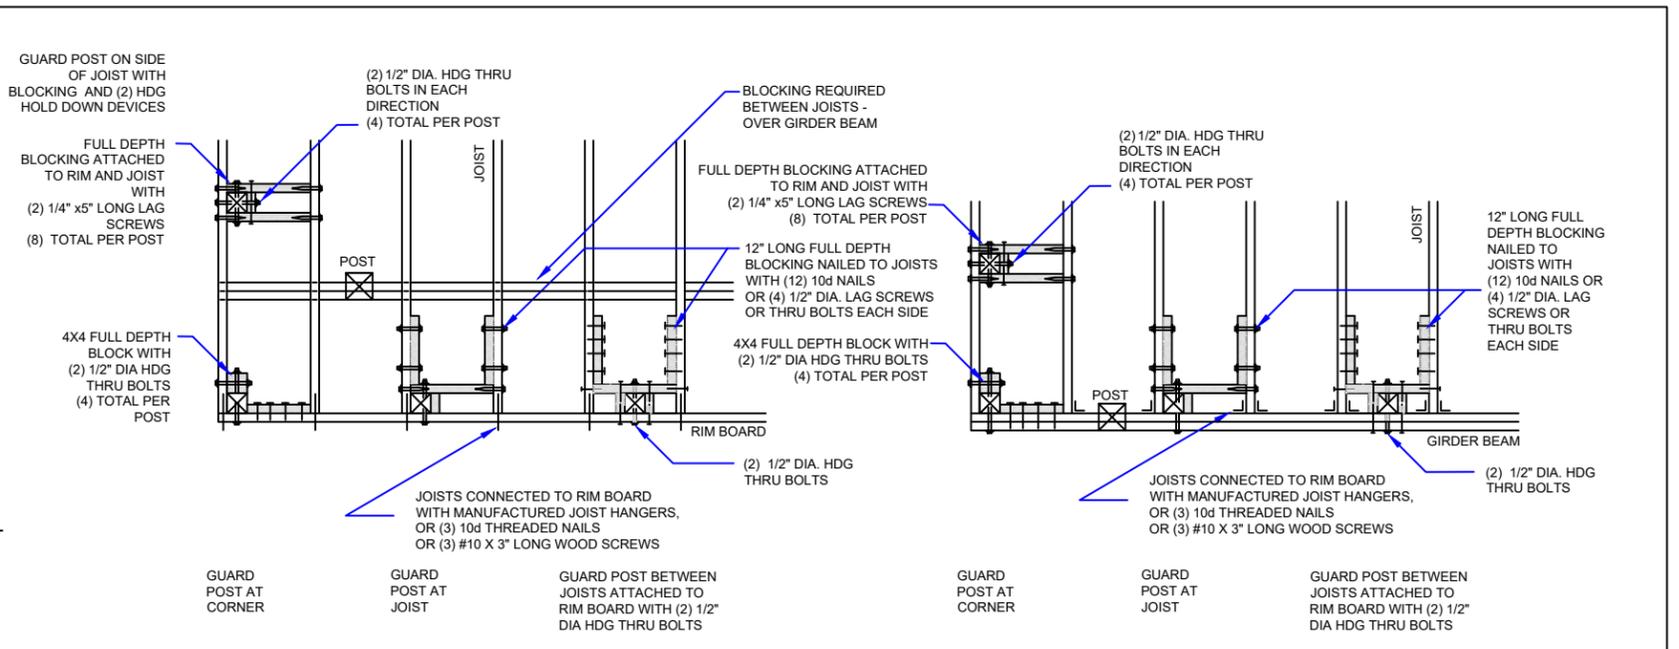


TYPICAL GUARD POST INTERIOR OF RIM BOARD ON CANTILEVERED DECK

TYPICAL GUARD POST INTERIOR OF GIRDER BEAM

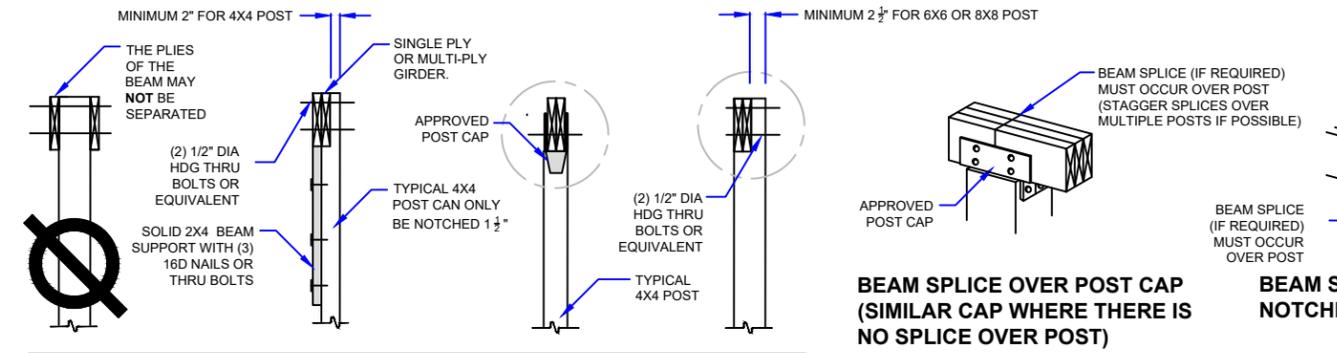


TYPICAL BEAM TO POST CONNECTION OPTIONS

A 4X4 POSTS CAN BE NOTCHED TO CARRY A 1-PLY BEAM OR CAN CARRY A 2-PLY BEAM USING A POST CAP.
A 6X6 POSTS CAN BE NOTCHED TO CARRY A 2-PLY BEAM OR CAN CARRY A 3-PLY BEAM USING A POST CAP.

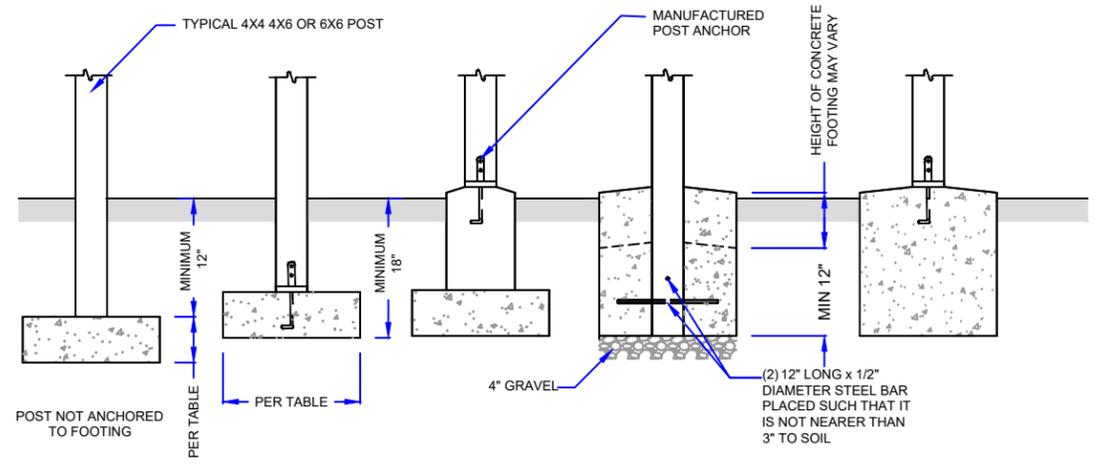

TYPICAL FOOTING OPTIONS

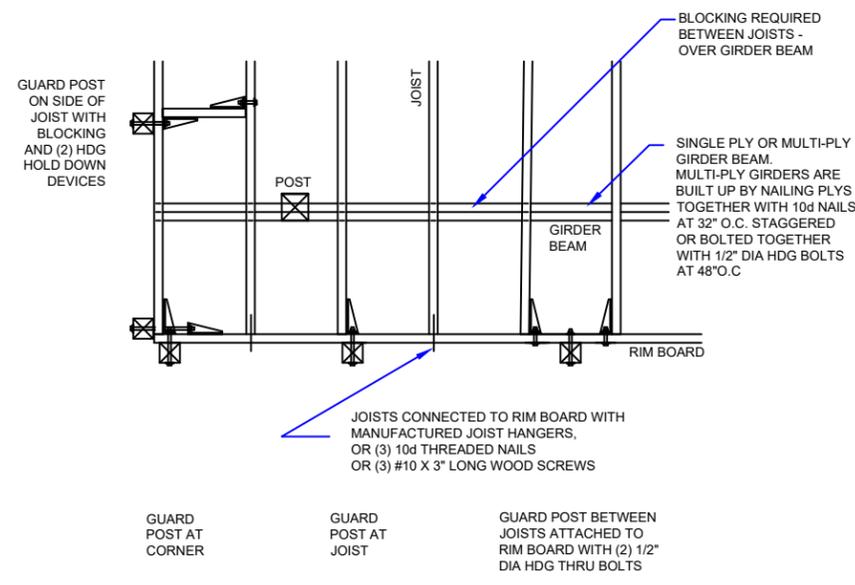

TYPICAL GUARD POST EXTERIOR OF RIM BOARD ON CANTILEVERED DECK

TYPICAL GUARD POST EXTERIOR OF GIRDER BEAM

CONNECTION DETAILS

STAIRS AND RAMPS

STAIR RISERS:

1. THE MAXIMUM RISER HEIGHT IS 8-1/4". THE MAXIMUM VARIATION BETWEEN THE TALLEST AND SHORTEST RISER IS 3/8".
2. OPEN RISERS ARE ALLOWED AS LONG AS THE OPENINGS DO NOT EXCEED 4"

STAIR TREADS

1. THE MINIMUM TREAD WIDTH IS 9". THE MAXIMUM VARIATION IN TREAD WIDTHS BETWEEN THE WIDEST AND NARROWEST IS 3/8".
2. THE TREAD NOSING SHALL PROJECT AT LEAST 3/4" AND NOT MORE THAN 1-1/4" BEYOND ANY SOLID RISER.

STRINGERS

1. ALL STRINGERS SHALL BE A MINIMUM OF 2x12 P.T. MATERIAL.
2. THREE STRINGERS SHALL BE PROVIDED FOR A 36" WIDE STAIR. NOTE: DO NOT OVER CUT NOTCHES.
3. STRINGERS SHALL NOT SPAN MORE THAN THE THE DIMENSIONS SHOWN, OTHERWISE, AN INTERMEDIATE POST IS REQUIRED. THE POST SHALL BE SUPPORTED ON A CONCRETE FOOTING AT LEAST 12" DEEP. THE STRINGER SHALL BE ATTACHED TO THE POST WITH (2) 1/2" DIA HDG THRU BOLTS.

GUARDRAILS (FREQUENTLY REFERRED TO AS "GUARDS")

1. GUARDRAILS ARE AN ASSEMBLY COMPRISED OF THE FOLLOWING COMPONENTS:
 - A GUARDRAIL CAP, TYPICALLY A 2X6 OR 5/4 BOARD LAID FLAT
 - TOP AND BOTTOM RAILS TO WHICH THE PICKETS ARE ATTACHED,
 - (GUARD) POSTS, AND
 - PICKETS.
2. GUARDRAILS ARE REQUIRED WHERE THE DISTANCE FROM THE WALKING SURFACE TO GRADE IS MORE THAN 30" MEASURED OUT 36" FROM THE FACE OF THE DECK.
3. THE TOP OF THE GUARDRAIL CAP MUST BE BETWEEN 34" AND 38" WHERE MEASURED FROM THE NOSING OF THE TREAD.
4. THE BOTTOM RAIL MUST BE LOCATED SO THAT A 6" SPHERE CANNOT PASS BETWEEN THE TRIANGLE FORMED BY THE RISER, TREAD AND BOTTOM RAIL.
5. THE GUARDS SHALL BE ABLE TO WITHSTAND A LOADING OF 200# IN ANY DIRECTION.

HANDRAILS (NOT TO BE CONFUSED WITH GUARDRAILS)

1. A HANDRAIL (TYPE 1 OR TYPE 2 PROFILE) IS REQUIRED ON AT LEAST ONE SIDE OF THE STAIR WHEN THERE ARE MORE THAN THREE RISERS.
2. THE HANDRAIL SHOULD BE MOUNTED BETWEEN 34" AND 38" ABOVE THE NOSING OF THE TREAD.
3. HANDRAILS HAVE TO "RETURN" TO THE POST OR WALL.

FOOTINGS

1. THE POST AT THE BOTTOM OF THE STRINGER MUST BE SET ON A CONCRETE FOOTING AT LEAST 12" IN DEPTH.

CONNECTIONS

1. THE BOTTOM OF P.T. STRINGERS SHALL BE ATTACHED TO EACH P.T. POST WITH (2) 1/2" DIA. HDG THRU BOLTS.
2. THE TOP OF P.T. STRINGERS SHALL BE ATTACHED WITH HDG MECHANICAL FASTENERS AND HDG THRU BOLTS TO EITHER:
 - A P.T. POST EMBEDDED IN THE GROUND ON A FOOTING (PREFERRED),
 - A SAW CUT POST,
 - A RIM BOARD WITH MECHANICAL FASTENERS (BUT END NAILING IS PROHIBITED).
 - OR DECK JOIST.


STAIR LANDINGS

1. WHEN A STAIRWAY EXCEEDS A VERTICAL HEIGHT OF 12', AN INTERMEDIATE LANDING SHALL BE PROVIDED.
2. LANDINGS SHALL BE AS WIDE AS THE STAIR WIDTH IT SERVICES (TYPICALLY 36").

RAMPS


1. RAMPS MAY BE STRAIGHT RUNS OR "L" OR "U" SHAPED.
2. RAMPS SHALL HAVE A MAXIMUM SLOPE OF 1:12 (THAT MEANS FOR EVERY INCH IN HEIGHT THE RAMP HAS TO CLIMB, IT SHALL BE ONE FOOT LONG).
3. WHERE RAMPS CHANGE DIRECTIONS, A LEVEL LANDING THE WIDTH OF THE RAMP IS REQUIRED.
4. HANDRAILS ARE REQUIRED ON AT LEAST ONE SIDE OF RAMP, AND MAY BE ATTACHED TO THE HOUSE
5. GUARDRAILS ARE REQUIRED WHERE THE HEIGHT OF THE RAMP ABOVE GRADE EXCEEDS 30."

HANDRAIL PROFILES

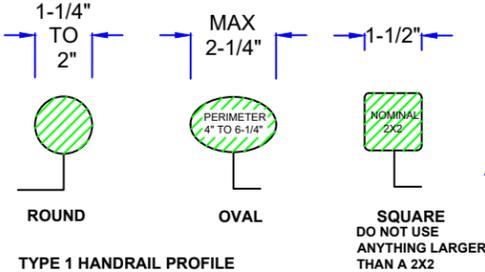

TYPE 1 HANDRAIL PROFILE

HANDRAILS WITH A CIRCULAR CROSS-SECTION SHALL HAVE AN OUTSIDE DIAMETER OF AT LEAST 1-1/4" AND NOT GREATER THAN 2". IF THE HANDRAIL IS NOT CIRCULAR, IT SHALL HAVE A PERIMETER OF AT LEAST 4" AND NOT GREATER THAN 6-1/4" WITH A MAXIMUM CROSS SECTION OF 2-1/4"

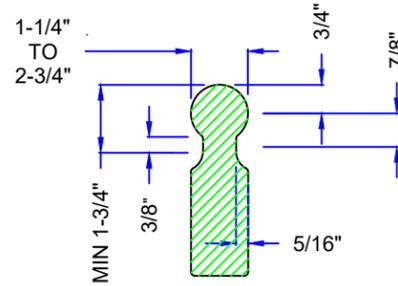


RECTANGULAR


TYPE 2 HANDRAIL PROFILE

HANDRAILS WITH A PERIMETER GREATER THAN 6-1/4" SHALL PROVIDE A GRASPABLE FINGER RECESS ON BOTH SIDES OF THE PROFILE. THE FINGER RECESS SHALL:

1. BEGIN WITHIN A DISTANCE OF 3/4" MEASURED VERTICALLY FROM THE TALLEST PORTION OF THE PROFILE AND
2. ACHIEVE A DEPTH OF AT LEAST 5/16" WITHIN 7/8" BELOW THE WIDEST PORTION OF THE PROFILE. THE REQUIRED DEPTH SHALL CONTINUE FOR AT LEAST 3/8" TO A LEVEL THAT IS NOT LESS THAN 1-3/4" BELOW THE TALLEST PORTION OF THE PROFILE. THE MINIMUM WIDTH OF THE HANDRAIL ABOVE THE RECESS SHALL BE 1-1/4" TO A MAXIMUM OF 2-3/4". EDGES SHALL HAVE A MINIMUM RADIUS OF .01"

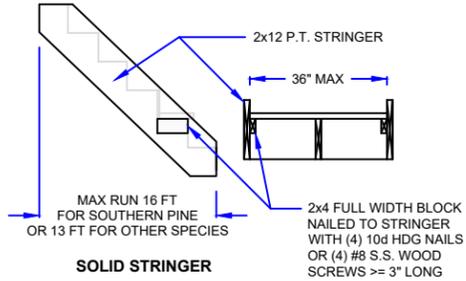


SOLID STRINGER

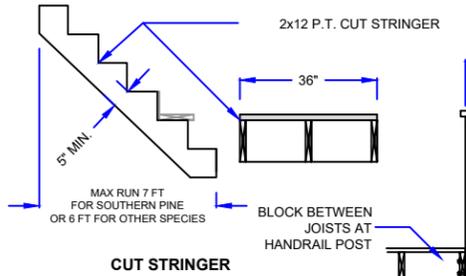

CUT STRINGER


OPTION
SAWED OFF HANDRAIL POST SECURED TO JOIST WITH (2) 1/2" DIA. HDG THRU BOLTS AND SECURED TO STRINGER WITH (2) 1/2" DIA HDG THRU BOLTS

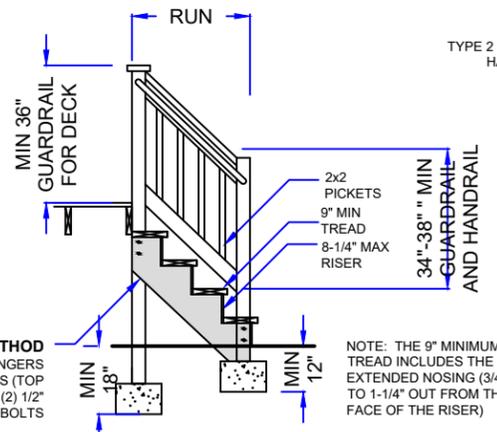

PREFERRED METHOD
2x12 P.T. STRINGERS ATTACHED TO POSTS (TOP AND BOTTOM) WITH (2) 1/2" DIA HDG THRU BOLTS

NOTE: THE 9" MINIMUM TREAD INCLUDES THE EXTENDED NOSING (3/4" TO 1-1/4" OUT FROM THE FACE OF THE RISER)

OPTION
STRINGER ATTACHED TO TRIMMER WITH FRAMING ANCHORS. TRIMMER ATTACHED TO CONNECTOR BOARD WITH (2) 1/2" DIA. HDG THRU BOLTS. CONNECTOR BOARD ATTACHED TO JOIST WITH (2) 1/2" DIA HDG THRU BOLTS

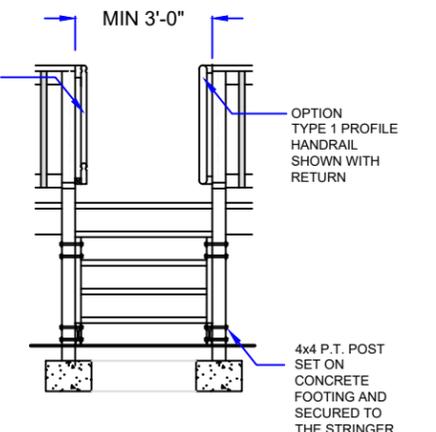


OPTION TYPE 1 PROFILE HANDRAIL SHOWN WITH RETURN


OPTION TYPE 2 PROFILE HANDRAIL SHOWN

4x4 P.T. POST SET ON CONCRETE FOOTING AND SECURED TO THE STRINGER WITH (2) 1/2" DIA HDG THRU BOLTS


STAIR DETAILS

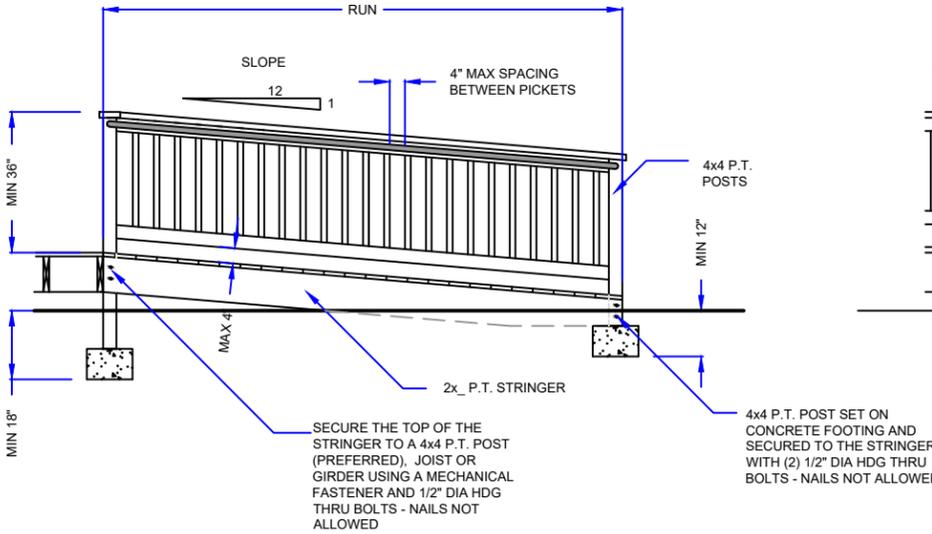

RAMP DETAILS

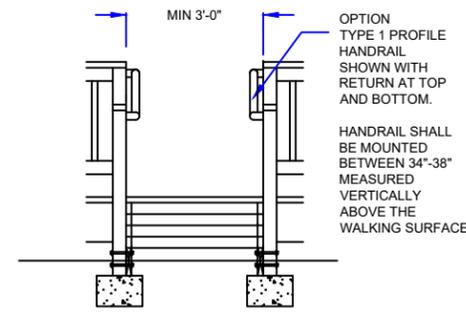

RAMP STRINGER DESIGN		
RUN LENGTH	MATERIAL	NUMBER OF SUPPORTS
0 FT - 12 FT	(2) 2x8	SUPPORT TOP AND BOTTOM
12 FT - 16 FT	(2) 2x10	SUPPORT TOP AND BOTTOM
16 FT - 19 FT	(2) 2x12	SUPPORT TOP AND BOTTOM
OVER 19 FT	na	ADD INTERMEDIATE POST TO REDUCE RUN LENGTH

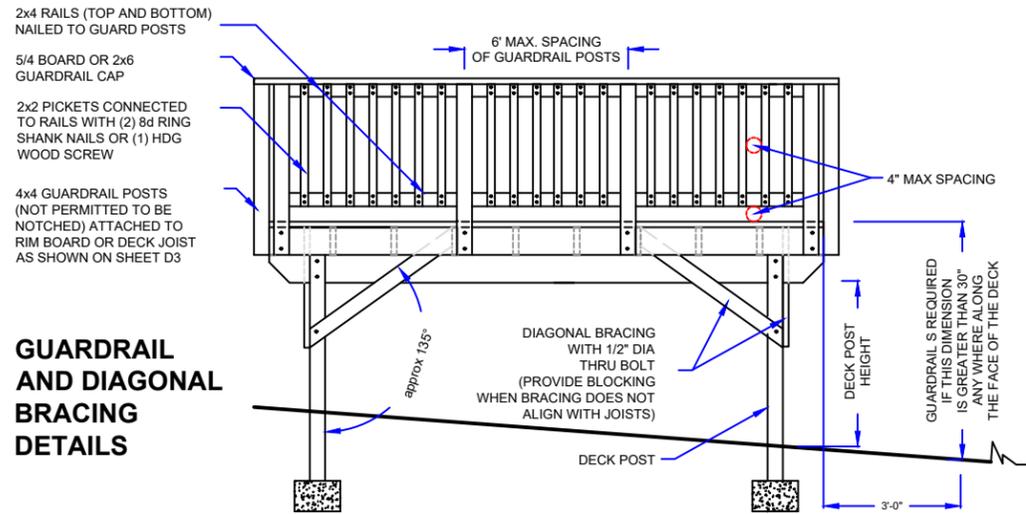

GUARDRAIL AND DIAGONAL BRACING DETAILS